




PLAN VIEW

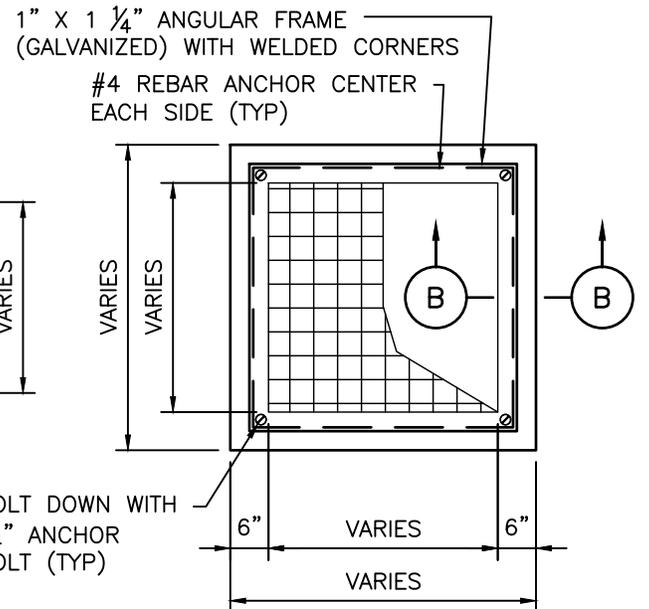

PLAN VIEW

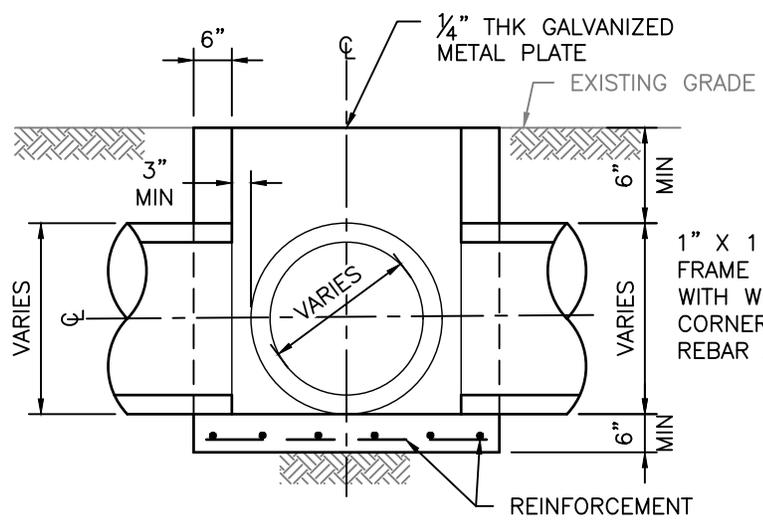

**SECTION A-A
JUNCTION BOX DETAIL**

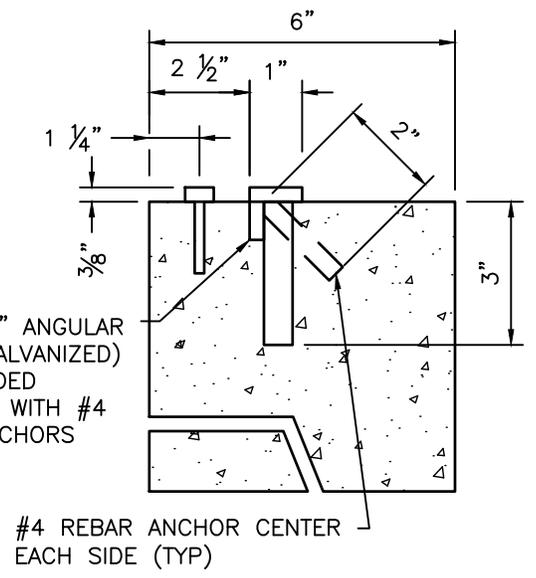

**SECTION B-B
LID FRAME DETAIL**

NOTES:

1. DETAIL TO BE USED WHERE STORM SEWER SIZE IS 24" DIA OR LESS.
2. FOR SEWER GREATER THAN 24" DIA USE TYPE C MANHOLE.

NOTES TO SPECIFIER:

1. WALL TO BE 6" CONCRETE.
2. NOT TO BE USED IN STREET. FOR AREA BETWEEN CURB AND PROPERTY LINE ONLY.

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE TEXAS ENGINEERING PRACTICE ACT. THE DESIGN REQUIREMENTS ON THIS STANDARD DO NOT PURPORT TO ADDRESS ALL OF THE SAFETY CONCERNS ASSOCIATED WITH THEIR USE. THE ENGINEER OF RECORD (EOR) IS TO REVIEW THESE DESIGN REQUIREMENTS AND BY AUTHORIZING THEIR USE, ACCEPTS RESPONSIBILITY FOR THEIR APPLICABILITY, ADEQUACY AND SAFETY. NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF HOUSTON FOR ANY PURPOSES WHATSOEVER. THE CITY OF HOUSTON ASSUMES NO RESPONSIBILITY FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

APPROVED BY:

Signed by:

 1BEBB22072F84DC...
CITY ENGINEER

Signed by:

 BE463EF0DF454EB...
DIRECTOR OF HPW

**CITY OF HOUSTON
HOUSTON PUBLIC WORKS STANDARD**

**STORM SEWER JUNCTION BOX WITH
LID OR GRATE TOP FOR MAXIMUM
OF 24" DIA STORM SEWER**

(SCALE: NOT TO SCALE)

EFF DATE: MAR-02-2026 | DWG NO: 02081-06