


NOTE:
 1. TRANSITION SLAB TO BE DESIGNED BY ENGINEER AND MEET MIN REQUIREMENTS OF COH STANDARD SPECIFICATION 02081.

TABLE-1

SEWER SIZE VS OPENING	
SEWER SIZE (INCHES)	OPENING SIZE (INCHES)
48"	36"
54"	36"
60"	42"
66" OR GREATER	48"

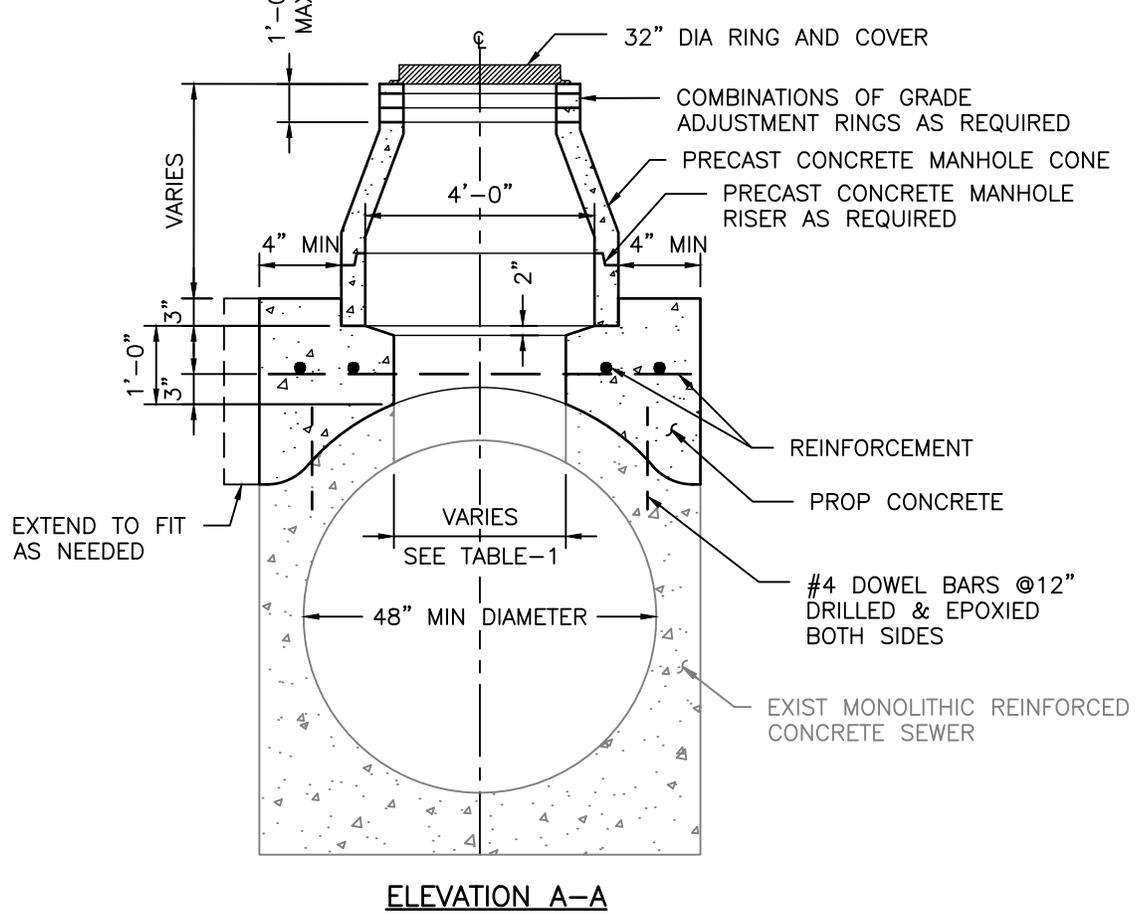

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE TEXAS ENGINEERING PRACTICE ACT. THE DESIGN REQUIREMENTS ON THIS STANDARD DO NOT PURPORT TO ADDRESS ALL OF THE SAFETY CONCERNS ASSOCIATED WITH THEIR USE. THE ENGINEER OF RECORD (EOR) IS TO REVIEW THESE DESIGN REQUIREMENTS AND BY AUTHORIZING THEIR USE, ACCEPTS RESPONSIBILITY FOR THEIR APPLICABILITY, ADEQUACY AND SAFETY. NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF HOUSTON FOR ANY PURPOSES WHATSOEVER. THE CITY OF HOUSTON ASSUMES NO RESPONSIBILITY FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

CITY OF HOUSTON
 HOUSTON PUBLIC WORKS STANDARD

STORM SEWER MANHOLE FOR EXISTING MONOLITHIC REINFORCED CONCRETE 48" DIA AND GREATER

(SCALE: NOT TO SCALE)

APPROVED BY:

Signed by: 
 1BEBB22072F84DC...
 CITY ENGINEER

Signed by: 
 BE463EF0DF454EB...
 DIRECTOR OF HPW

EFF DATE: MAR-02-2026 | DWG NO: 02082-17