



PLAN VIEW
COVER NOT SHOWN

NOTE:

1. PROVIDE CLASS A CONCRETE WITH A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AND GRADE 60 REINFORCING STEEL IN ACCORDANCE WITH COH STANDARD SPECIFICATION SECTION 03315.
2. THE REINFORCEMENT DESIGN WILL BE BY THE ENGINEER OF OF RECORD TO DESIGN REINFORCEMENT AND ENSURE THE DESIGN MEETS THE PROJECT REQUIREMENTS.

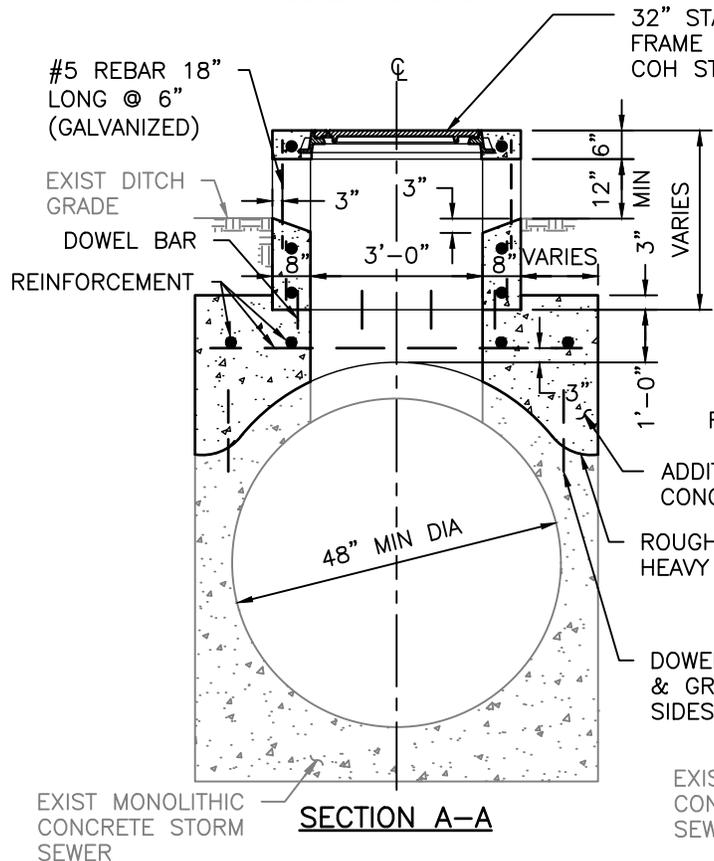

SECTION A-A

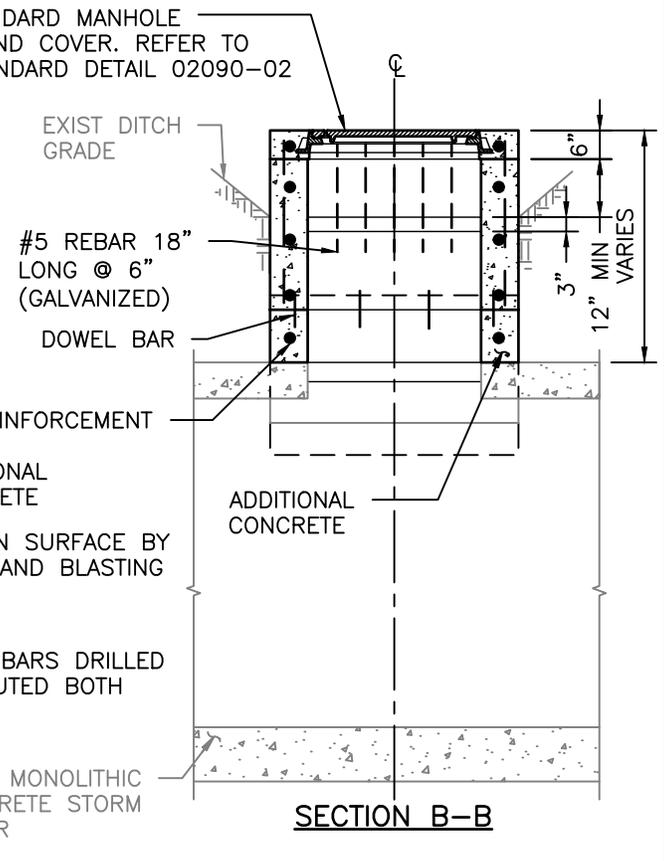

SECTION B-B

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE TEXAS ENGINEERING PRACTICE ACT. THE DESIGN REQUIREMENTS ON THIS STANDARD DO NOT PURPORT TO ADDRESS ALL OF THE SAFETY CONCERNS ASSOCIATED WITH THEIR USE. THE ENGINEER OF RECORD (EOR) IS TO REVIEW THESE DESIGN REQUIREMENTS AND BY AUTHORIZING THEIR USE, ACCEPTS RESPONSIBILITY FOR THEIR APPLICABILITY, ADEQUACY AND SAFETY. NO WARRANTY OF ANY KIND IS MADE BY THE CITY OF HOUSTON FOR ANY PURPOSES WHATSOEVER. THE CITY OF HOUSTON ASSUMES NO RESPONSIBILITY FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

APPROVED BY:

Signed by:

1BE8B22072F84DC...
CITY ENGINEER

Signed by:

BE463EF0DF454EB...
DIRECTOR OF HPW

CITY OF HOUSTON
HOUSTON PUBLIC WORKS STANDARD

STORM SEWER TYPE "E" INLET
ON EXIST MONOLITHIC CONC
SEWERS OF 48" DIA & GREATER

(SCALE: NOT TO SCALE)

EFF DATE: MAR-02-2026 DWG NO: 02632-10