


NOTE:

1. THE CONTRACTOR SHALL CENTER A MINIMUM OF 18 FOOT JOINT OF DUCTILE IRON PIPE OR C900 PVC PIPE ACROSS THE CENTER OF THE PROPOSED STORM SEWER.

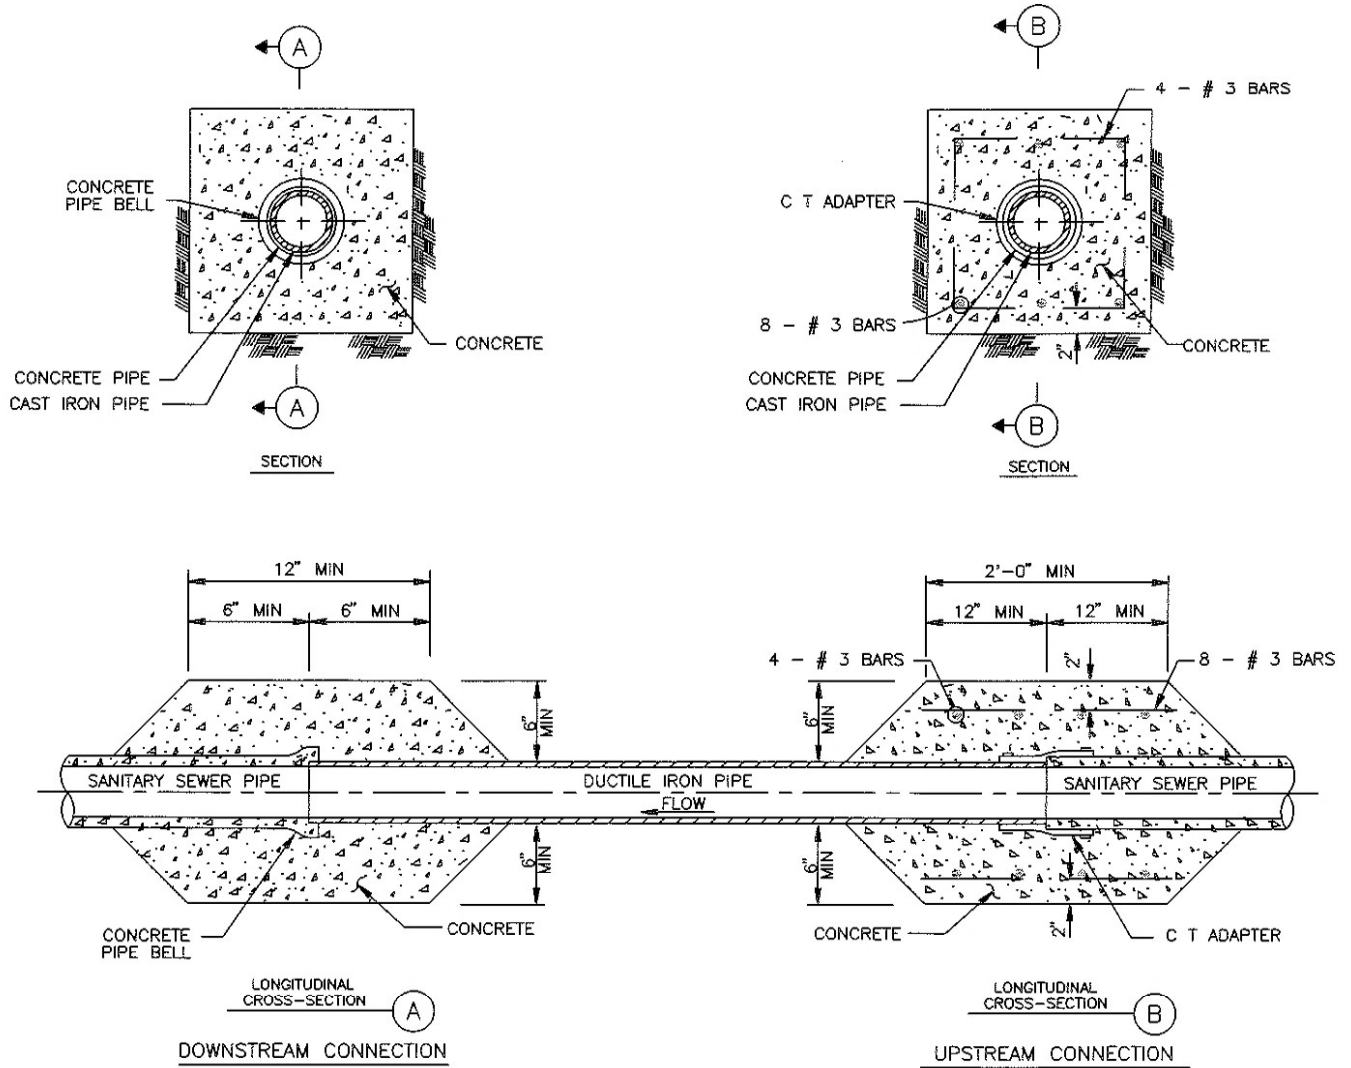

| | |
|--|---|
| CITY OF HOUSTON DEPARTMENT OF PUBLIC WORKS AND ENGINEERING ENGINEERING, CONSTRUCTION AND REAL ESTATE DIVISION | |
| SANITARY SEWER DUCTILE IRON PIPE STORM SEWER CROSSING (NOT TO SCALE) | |
| APPROVED BY: <i>E. Audaprin</i> CITY ENGINEER | APPROVED BY: <i>[Signature]</i> DIRECTOR OF PUBLIC WORKS AND ENGINEERING |
| EFF DATE: OCT-01-2002 | DWG NO: 02531-03 |