



6" TURBINE METER
PLAN VIEW

CITY OF HOUSTON OWNER

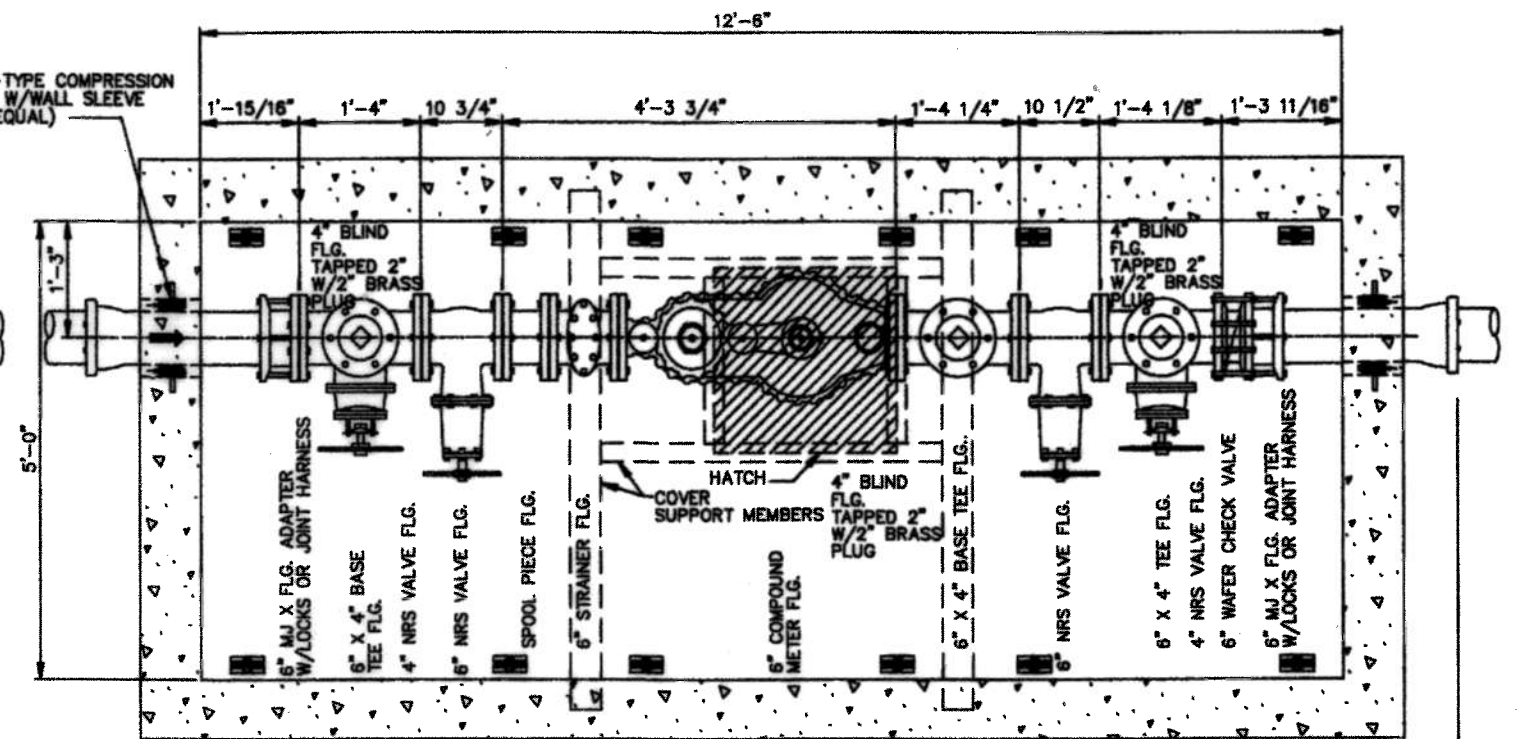


6" COMPOUND METER
PLAN VIEW

CITY OF HOUSTON OWNER

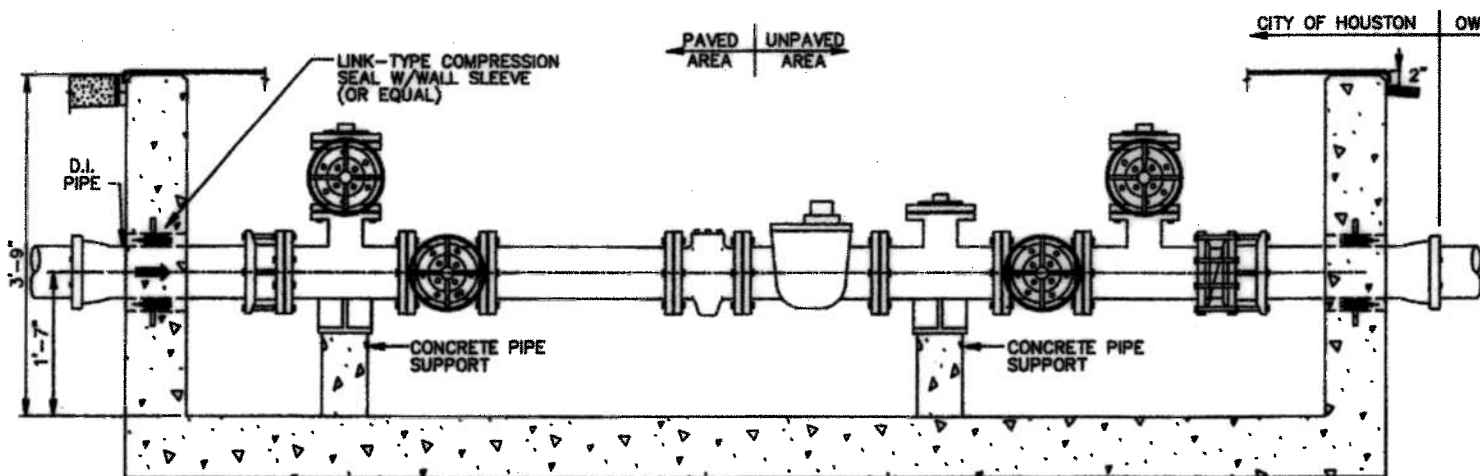

6" TURBINE METER
ELEVATION VIEW

CITY OF HOUSTON OWNER

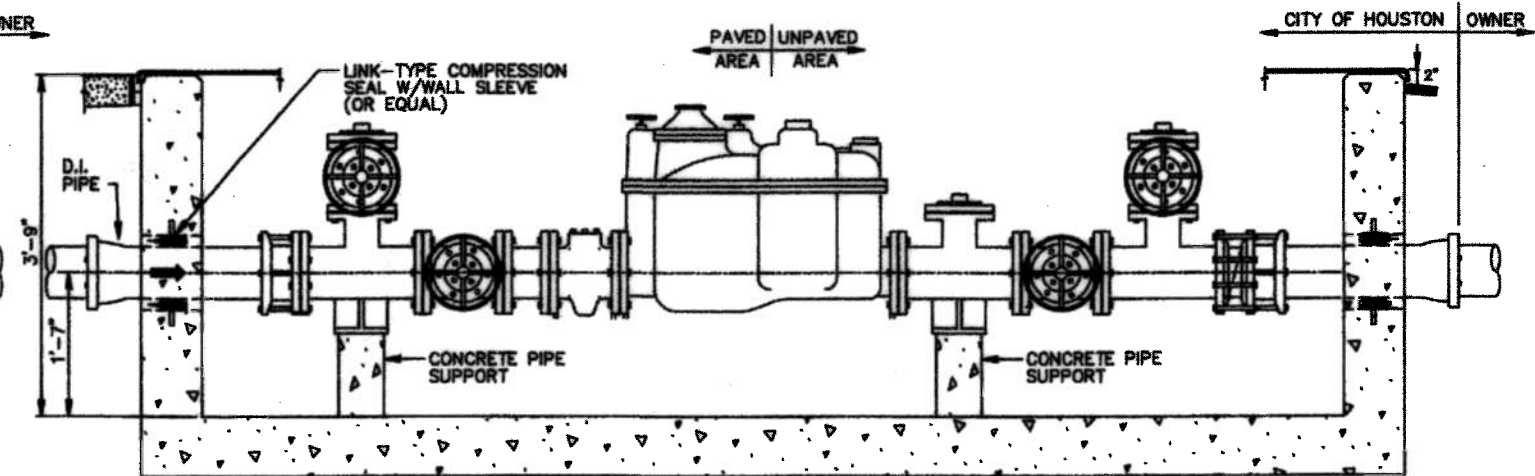


6" COMPOUND METER
ELEVATION VIEW

CITY OF HOUSTON OWNER

NOTES:

1. SEE CITY OF HOUSTON STANDARD SPECIFICATION, "WATER METERS".
2. METER INSTALLATION SHALL BE IN ACCORDANCE WITH "DESIGN DIVISION SPECIFICATIONS FOR WATER MAIN CONSTRUCTION AND MATERIALS".
3. DIMENSIONS INCLUDE GASKET THICKNESS REQUIRED BETWEEN EACH FLANGE.
4. SEE STRUCTURAL SHEETS.
5. OMIT SPOOL PIECE IF IT IS LESS THAN 6" IN LENGTH.

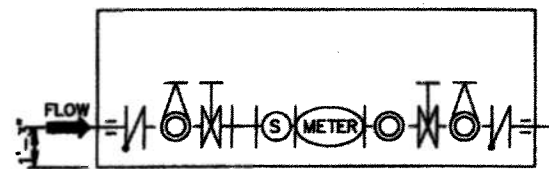

ALTERNATE
PLAN VIEW
(SEE NOTE 3 ON COVER PLATE PLAN)

CITY OF HOUSTON
DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

TYPICAL PIPING ARRANGEMENT
6" TURBINE/COMPOUND METER
STANDARD SERVICE
(NOT TO SCALE)

APPROVED BY:

[Signature]
CITY ENGINEER

APPROVED BY:

[Signature]
DIRECTOR OF PUBLIC
WORKS AND ENGINEERING

EFF DATE: JUL-01-2010

DWG NO: 02526-04