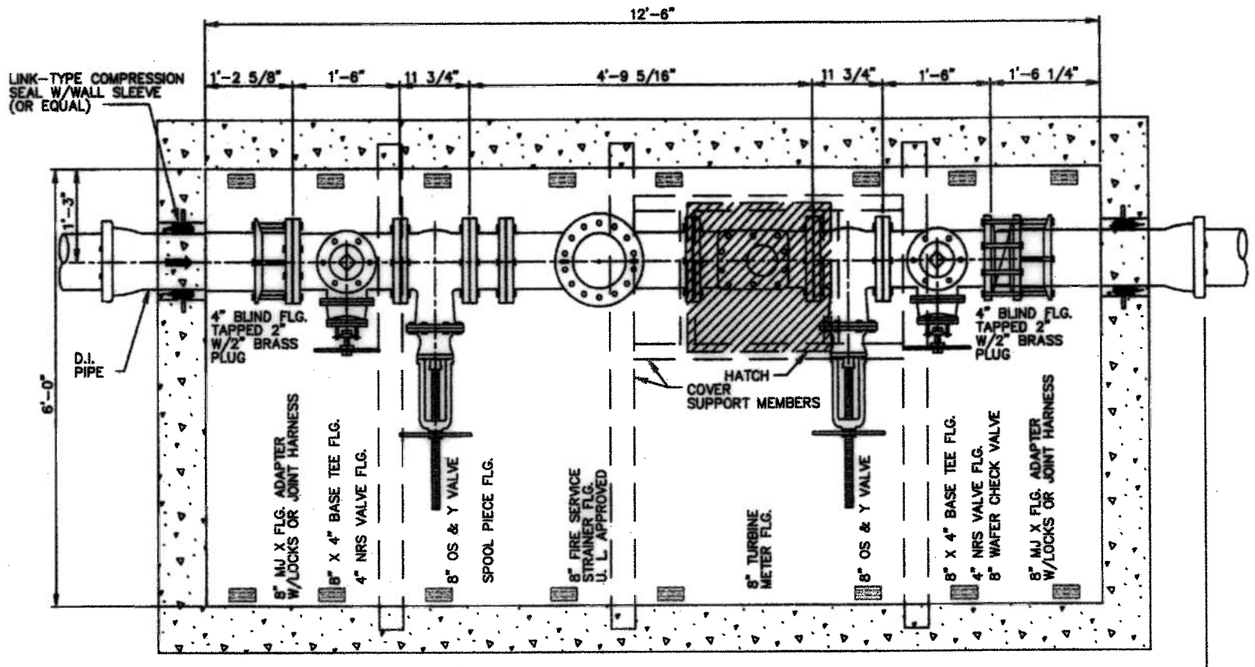


8" FIRE SERVICE TURBINE METER
PLAN VIEW

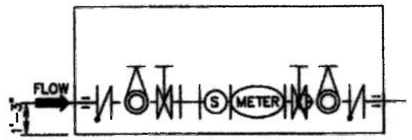


ALTERNATE
PLAN VIEW
(SEE NOTE 3 ON COVER PLATE PLAN)

## GENERAL NOTES:

1. SEE CITY OF HOUSTON STANDARD SPECIFICATION, "WATER METERS".
2. METER INSTALLATION SHALL BE IN ACCORDANCE WITH "DESIGN DIVISION SPECIFICATIONS FOR WATER MAIN CONSTRUCTION AND MATERIALS".
3. DIMENSIONS INCLUDE GASKET THICKNESS REQUIRED BETWEEN EACH FLANGE.
4. SEE STRUCTURAL SHEETS.
5. OMIT SPOOL PIECE IF IT IS LESS THAN 6" IN LENGTH.

CITY OF HOUSTON | OWNER

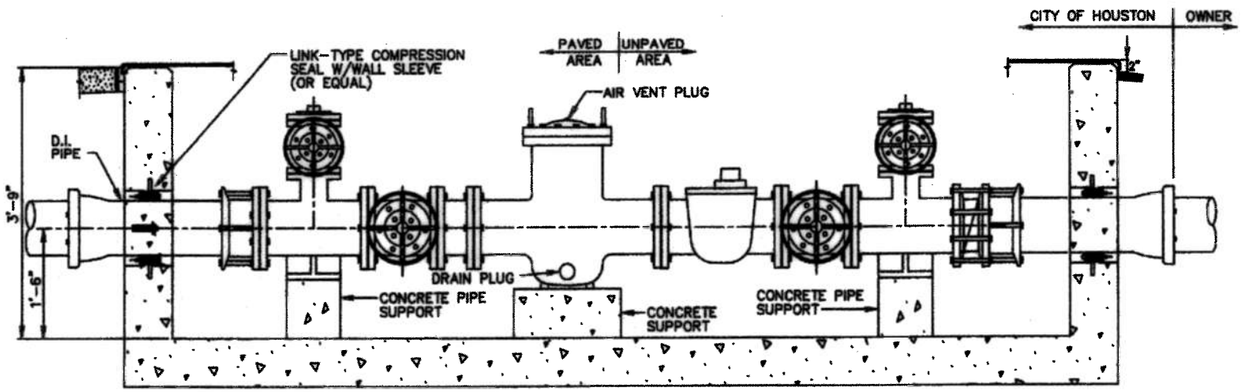


8" FIRE SERVICE TURBINE METER
ELEVATION VIEW

| CITY OF HOUSTON<br>DEPARTMENT OF PUBLIC WORKS AND ENGINEERING | |
|---|---|
| TYPICAL PIPING ARRANGEMENT<br>8" FIRE SERVICE TURBINE METER<br>STANDARD SERVICE<br>(NOT TO SCALE) | |
| APPROVED BY<br>CITY ENGINEER | APPROVED BY<br>DIRECTOR OF PUBLIC WORKS AND ENGINEERING |
| EFF DATE: JUL-01-2010 | DWG NO: 02526-08 |

CDH