


**NOTES:**

1. SEE CITY OF HOUSTON STANDARD SPECIFICATION, "WATER METERS".
2. METER INSTALLATION SHALL BE IN ACCORDANCE WITH "DESIGN DIVISION SPECIFICATIONS FOR WATER MAIN CONSTRUCTION AND MATERIALS".
3. DIMENSIONS INCLUDE GASKET THICKNESS REQUIRED BETWEEN EACH FLANGE.
4. SEE STRUCTURAL SHEETS.
5. OMIT SPOOL PIECE IF IT IS LESS THAN 6" IN LENGTH.

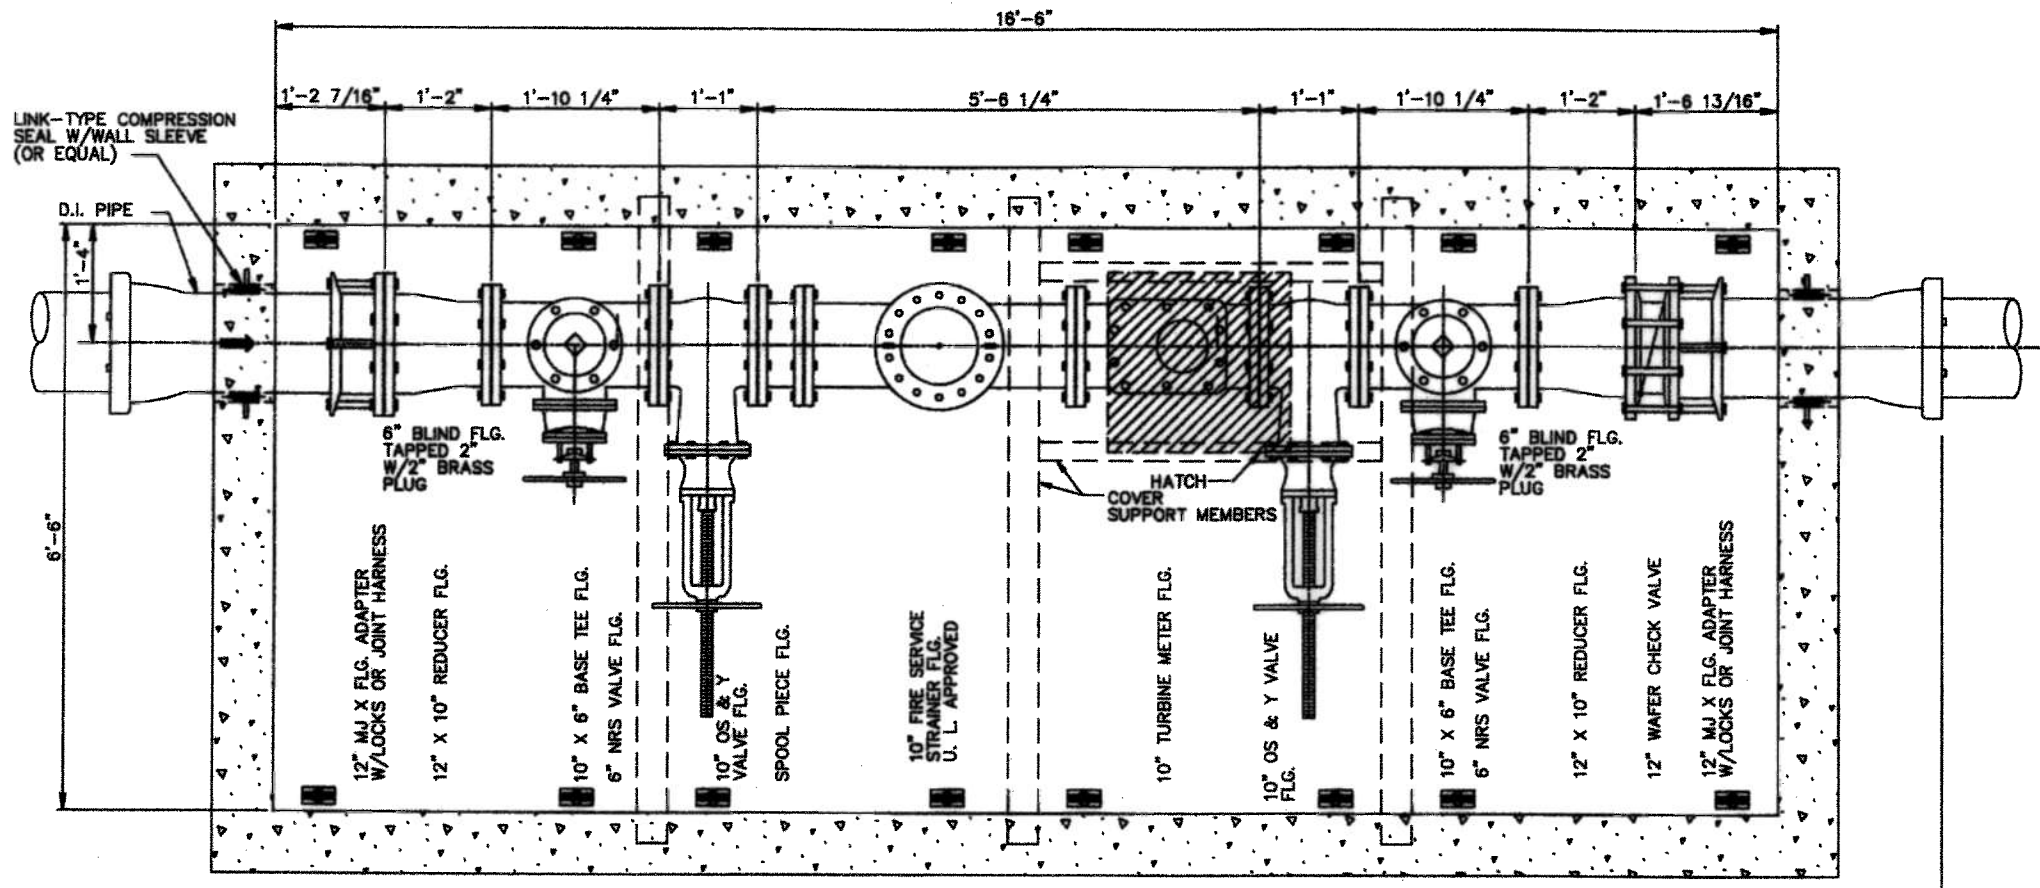


**10" FIRE SERVICE TURBINE METER  
PLAN VIEW**

CITY OF HOUSTON OWNER



**ALTERNATE  
PLAN VIEW  
(SEE NOTE 3 ON COVER PLATE PLAN)**

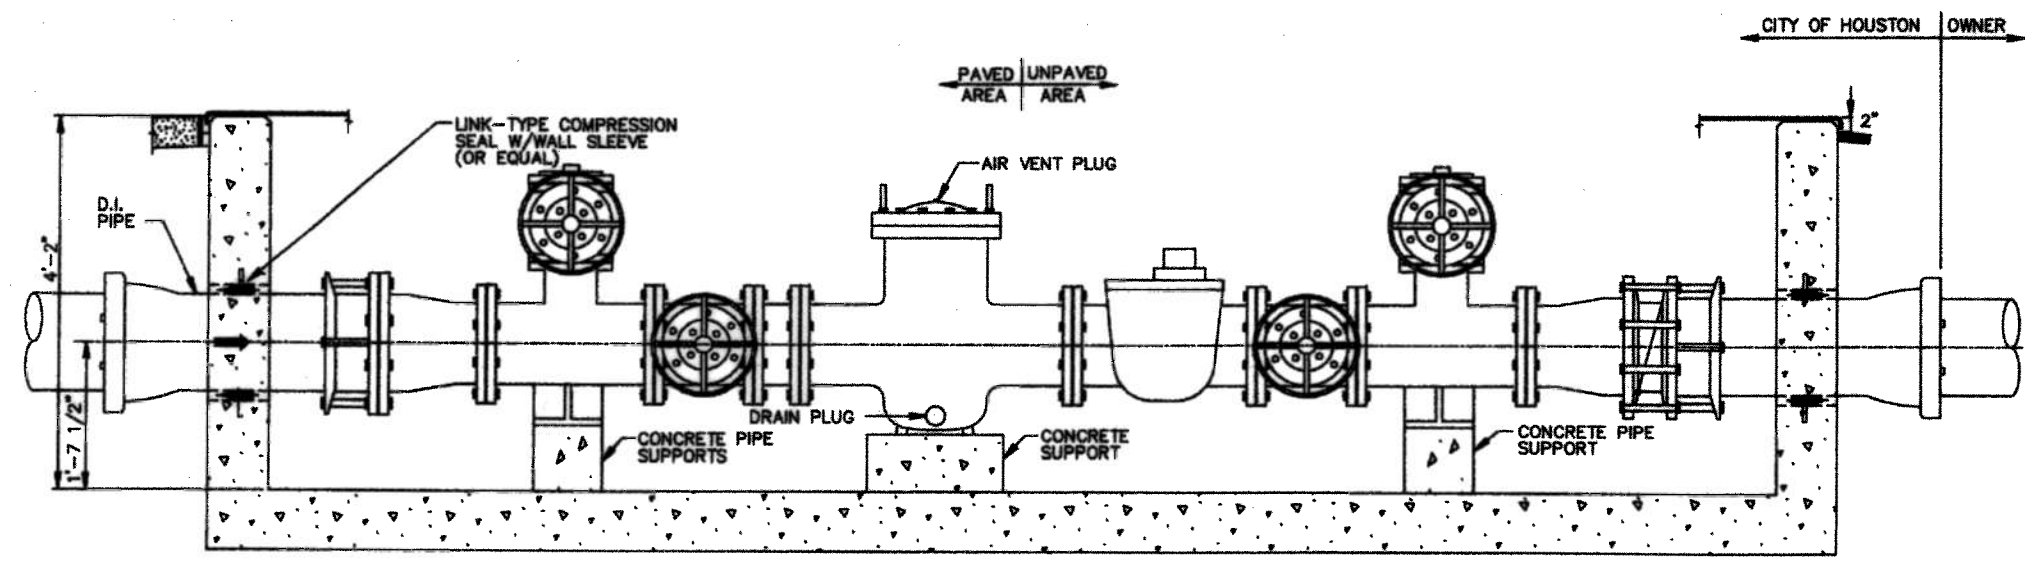

**10" FIRE SERVICE TURBINE METER  
ELEVATION VIEW**

CITY OF HOUSTON OWNER

<b>CITY OF HOUSTON</b> DEPARTMENT OF PUBLIC WORKS AND ENGINEERING	
TYPICAL PIPING ARRANGEMENT 10" FIRE SERVICE TURBINE METER STANDARD SERVICE (NOT TO SCALE)	
APPROVED BY  CITY ENGINEER	APPROVED BY  DIRECTOR OF PUBLIC WORKS AND ENGINEERING
EFF DATE: JUL-01-2010	DWG NO: 02526-09